
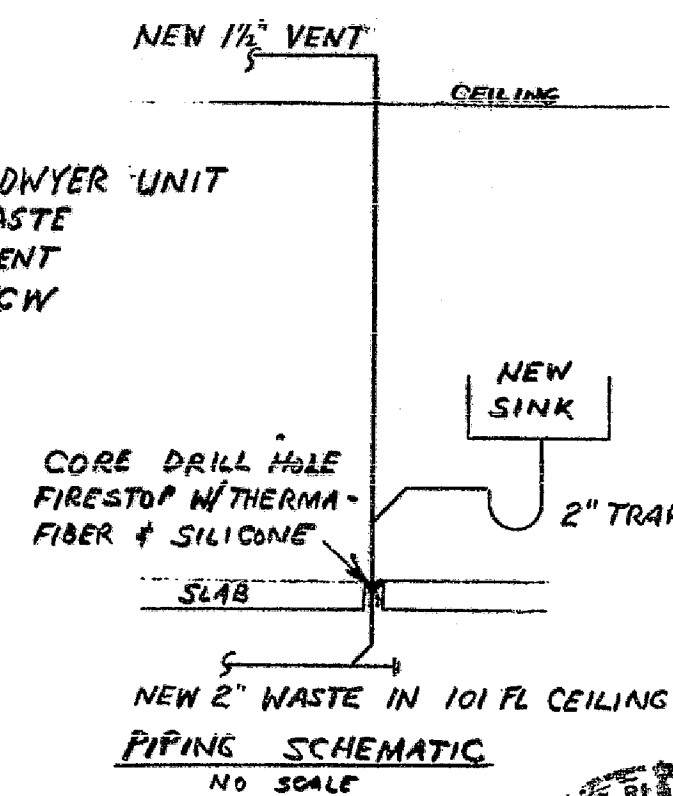


NEW 2" WASTE BELOW FL.  
 NEW 1 1/2" VENT IN H.C.  
 NEW 1/2" H.W. IN H.C.  
 NEW 1/2" C.W. IN H.C.

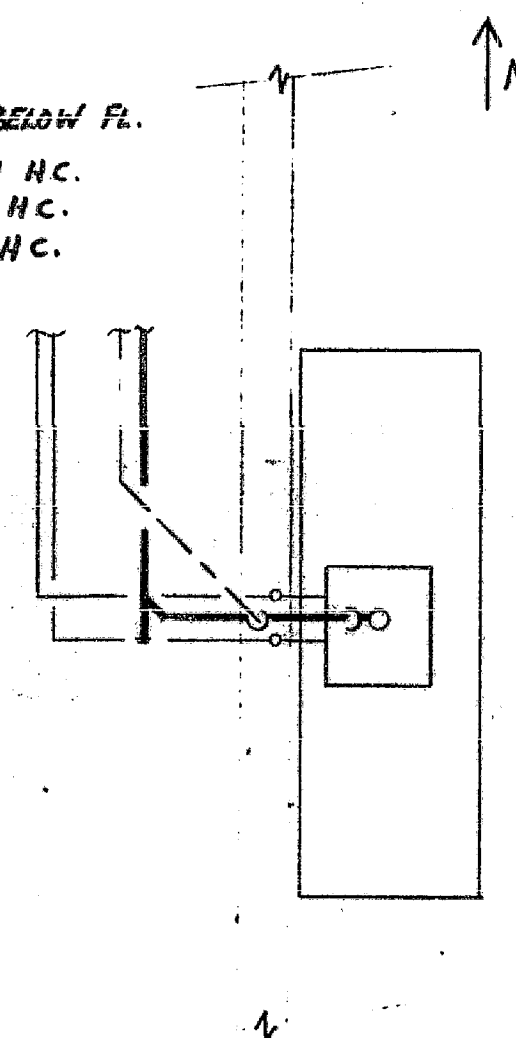


# LEGEND & SYMBOLS

	EXIST. DOUBLE POUCH - REMOVE
	EXIST. SINGLE POUCH - REMOVE
	NEW DUCTWORK
	EXIST. DUCTWORK
	EXIST. DUCTWORK - REMOVE
	EXIST. FULL CAPACITY INDUCTION UNIT
	RELOCATED 1 1/2 CAP INDUCTION UNIT
	EXIST. 1 1/2 CAP INDUCTION UNIT
	NEW CEILING DIFFUSER
	NEW CEILING GRILL
	EXIST. EXHAUST FAN - REMOVE
	RELOCATED THERMOSTAT
	EXIST. MOTORIZED DAMPER
	NO. OF CFM - BALANCE
	GATE VALVE
	REDUCER
	STRAINER
	UNION
	PRESSURE GAGE
	THERMOMETER
	PLUG VALVE
	WATER REGULATING VALVE
	CHECK VALVE

TCA/TAA NO. 2372  
 DATE APPROVED 11/4/82  
 WTE-577.689

PLUMBING NOTES  
 1. WATER PIPING SHALL BE TYPE TP COPPER W/BRAZED JOINTS  
 2. WASTE & VENT PIPING SHALL BE NO-HUB  
 3. UTILIZE EXIST'G VALVES FOR NEW INSTALLATION.

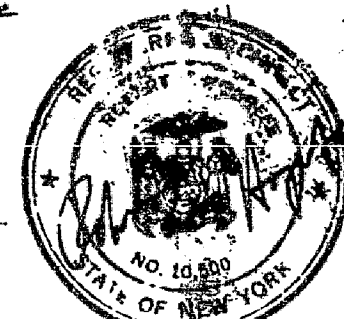

INTRADESIGN GROUP INC. 170 FIFTH AVE N.Y. N.Y.	
MECHANICAL LEGEND & DETAILS	ISSUE 9/28/82
	REV 10/28/82
TELERATE SYSTEMS INC. ONE WORLD TRADE CENTER NY, N.Y. 10048	

WTE-83